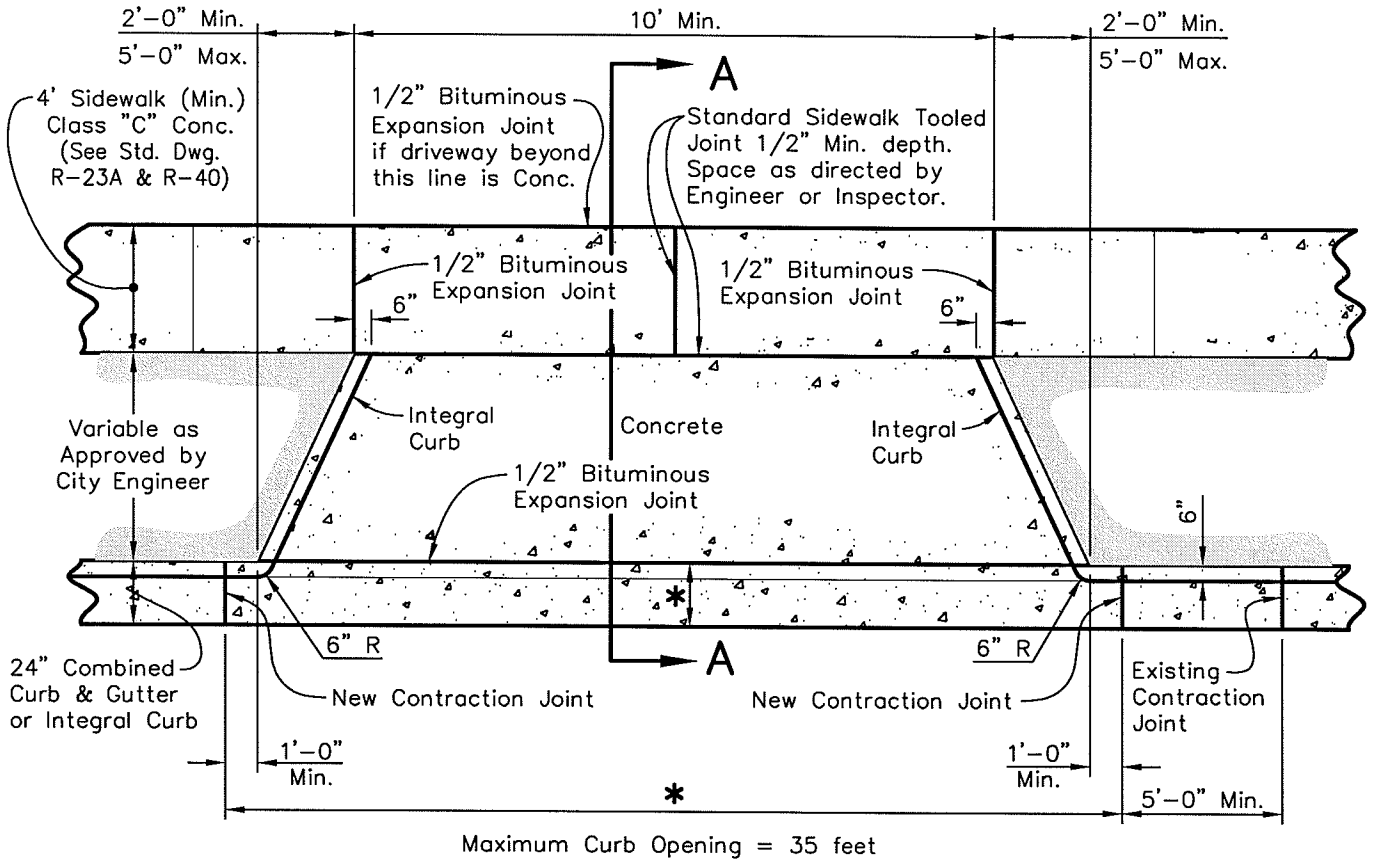

Maximum Curb Opening = 35 feet

PLAN

NOTES

1. All materials and construction to conform to Item 452 of State of Ohio Department of Transportation Specifications. (Class "C" Conc., 6-1/2 sacks per cu. yd. 6% air entrainment). Particular attention shall be given to finish and curing.
2. Subgrade excavated below the prescribed grade shall be filled with an approved crushed aggregate and compacted as directed.
3. When directed by the City, 2" Duct for street light cable shall be laid under driveway approaches prior to pouring approaches. Duct shall be placed 4' back of curb and 24" below proposed finished grade.
4. Surfaces shall be broom finish as directed by the Director of Public Service. All joints and edges shall be tooled after broom finish.
5. Circular approach may only be used upon approval of the City Engineer.

* = Minimum limits of combined curb & gutter or integral curb to be removed if curb has not yet been previously dropped. All joints to be sawed and provision made for proper contraction joints.

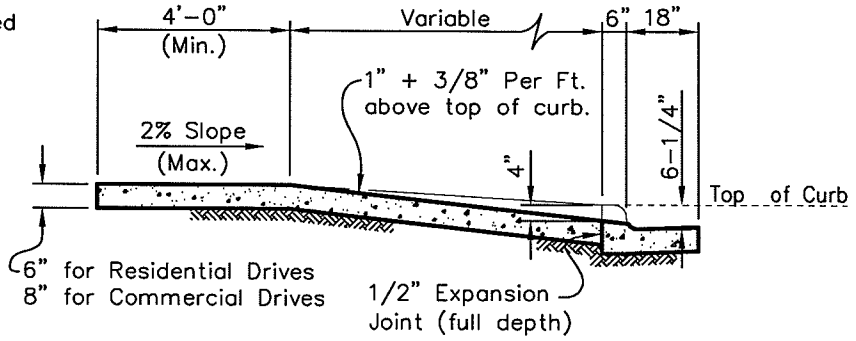

SECTION "A-A"

ORD. NO. 1169 PASSED AUGUST 13, 1962

STANDARD DIMENSIONS FOR

DRIVEWAY ENTRANCE FLARED APPROACH

CITY OF REYNOLDSBURG, OHIO

STANDARD CONSTRUCTION DRAWING

Rev.	Date	Dwg. No.
1-15-02	10-09-61	R-17